


NEW	REVISIONS			
2-1972	11-2-98	6-1-00	7-31-07	10-1-09


ST. LOUIS COUNTY PROJ.	
SHEET NUMBER	TOTAL SHEETS

PLAN


RESIDENTIAL ENTRANCE WITH ROLLED CURB

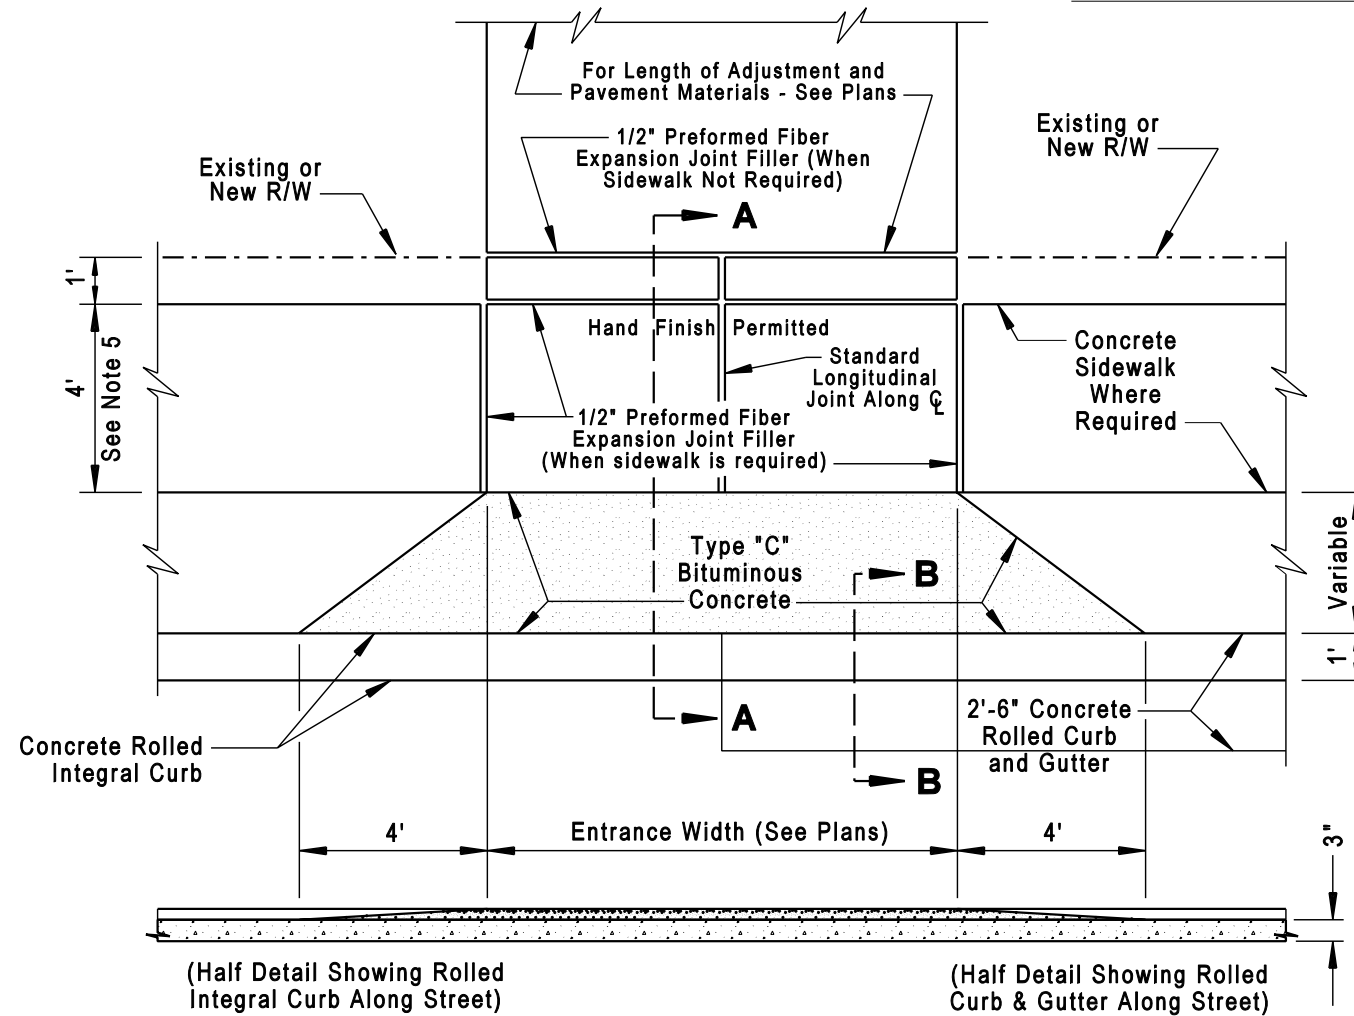

ELEVATION

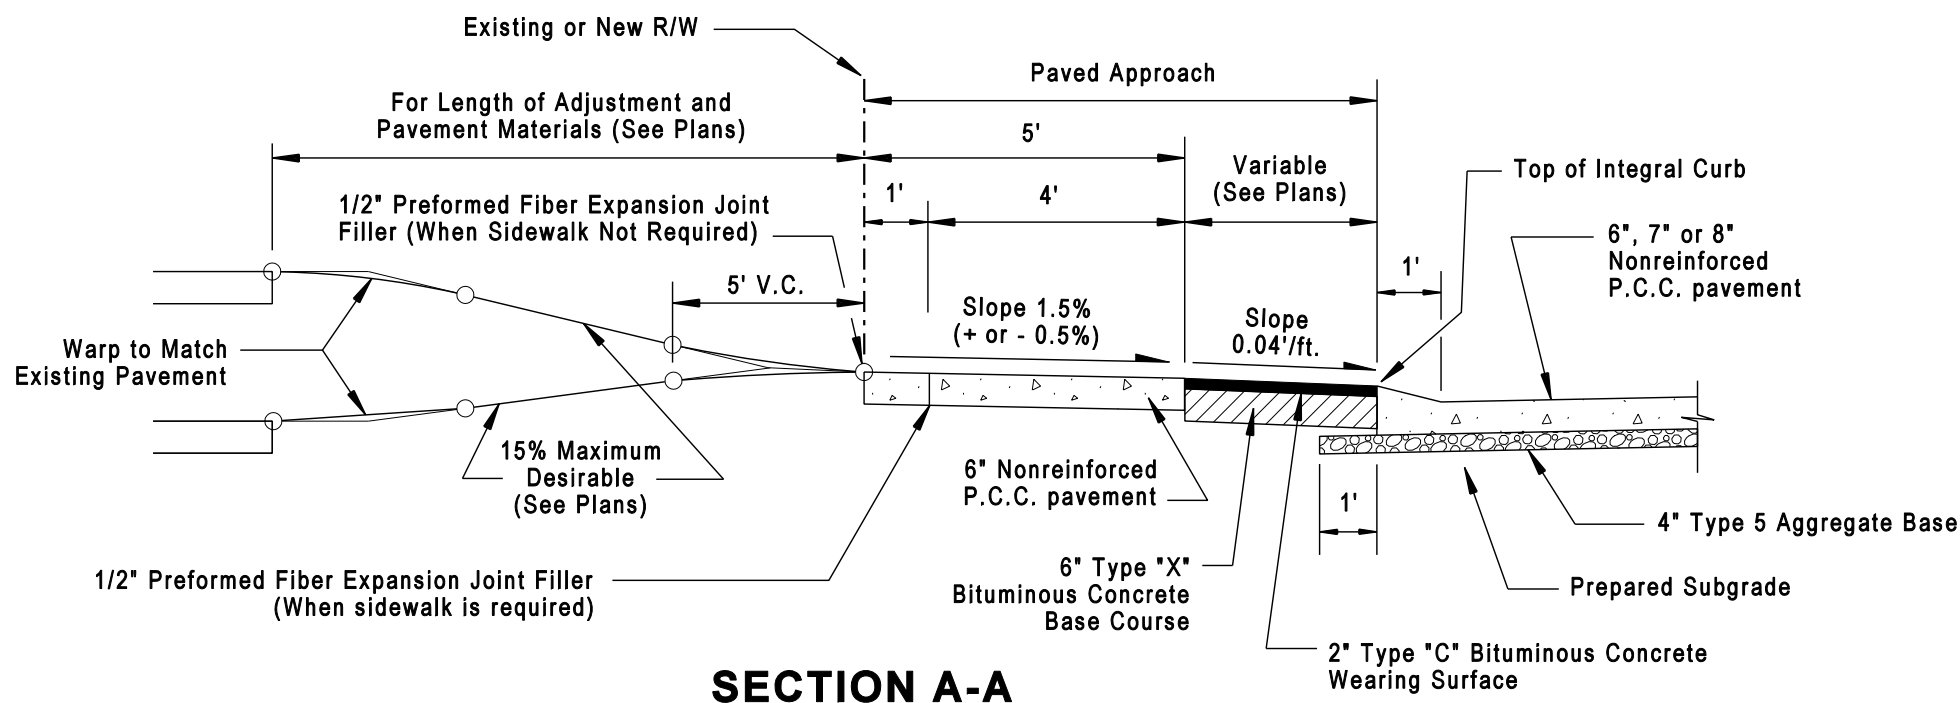

SECTION A-A

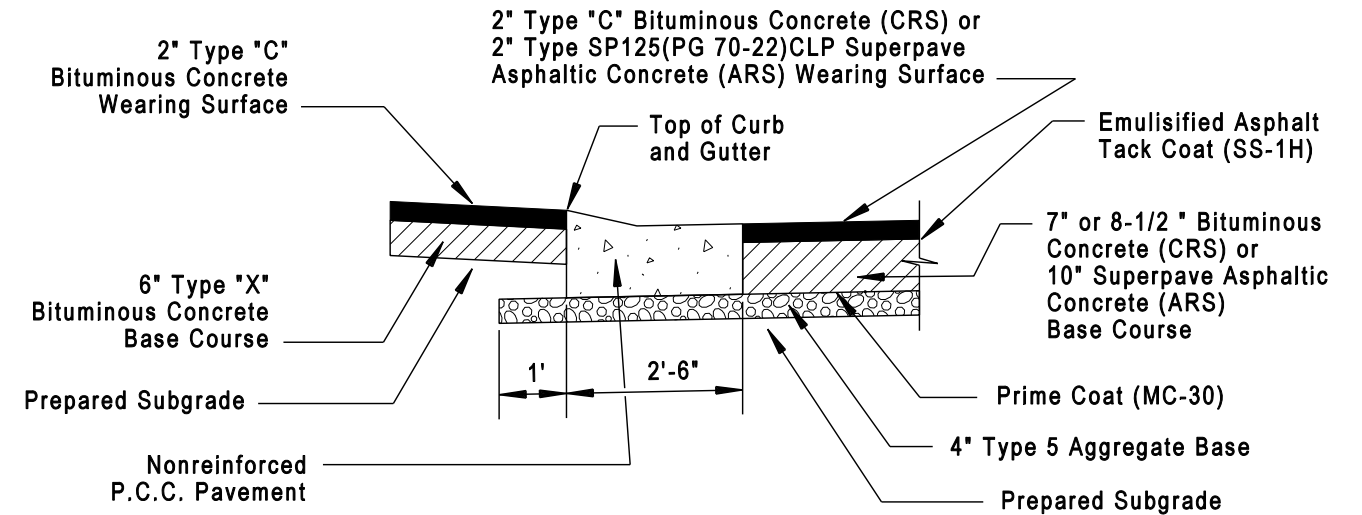

SECTION B-B

GENERAL NOTES

- 1) Do not scale drawing, follow dimensions.
- 2) All premolded expansion joints shall extend from subgrade to 1/2" below top of finish surface of concrete. The upper 1/2" joint sealant to conform to Section 1057.1.3.2 of the Saint Louis County Standard Specifications for Highway Construction.
- 3) Curb and joint dimensions shown in Pavement Construction Details for "Joints and Curbs". Standard Drawing C502.03.
- 4) The thickness of the first section of sidewalk on each side of the entrance shall be increased to match the driveway approach pavement thickness (8").
- 5) Premolded expansion joint filler material shall consist of a solid polymer foam or sponge rubber product that exhibits at least 95% recovery when tested in accordance with ASTM D-1752.

SAINT LOUIS COUNTY DEPARTMENT OF HIGHWAYS AND TRAFFIC CLAYTON, MISSOURI	
ENTRANCE CONSTRUCTION DETAILS RESIDENTIAL BITUMINOUS CONCRETE ENTRANCE	
REVISION DATE: <u>October 1, 2009</u>	
DRAWING C608.03	